


SECTION A-A

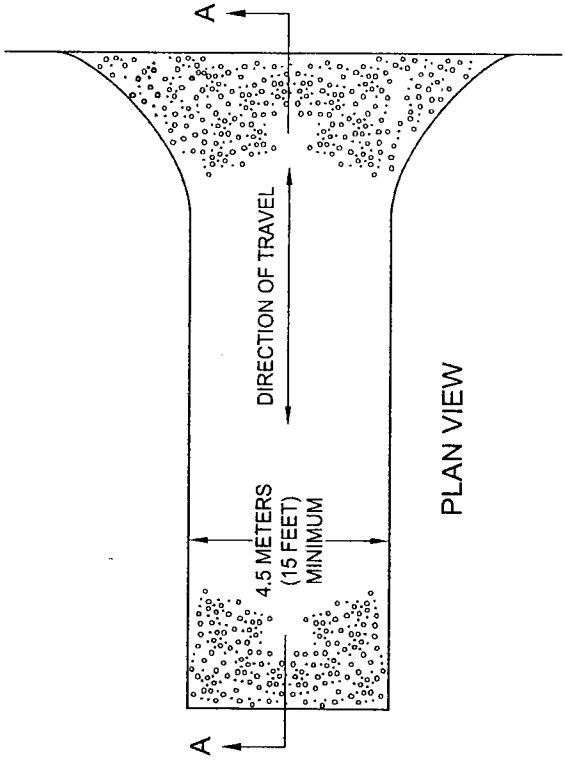

PLAN VIEW

NOTES

1. STABILIZED CONSTRUCTION SITE ACCESS SHALL BE CONSTRUCTED OF 75 - 125 MM (3 - 6 INCH) WASHED, WELL GRATED GRAVEL OR CRUSHED ROCK. MATERIAL SHALL BE PLACED TO A MINIMUM THICKNESS OF 150 MM (6 INCHES).
2. LENGTH OF ENTRANCE SHALL BE A MINIMUM OF 15 METERS (50 FEET). WIDTH SHALL BE A MINIMUM OF 4.5 METERS (15 FEET) OR GREATER IF NECESSARY TO COVER ALL VEHICULAR INGRESS AND EGRESS. PROVIDE AMPLE TURNING RADI.
3. THE ENTRANCE SHALL BE KEPT IN GOOD CONDITION BY OCCASIONAL TOP DRESSING WITH MATERIAL AS SPECIFIED IN NOTE 1.
4. ACCESS SHALL BE INSPECTED WEEKLY DURING PERIODS OF HEAVY USAGE, MONTHLY DURING NORMAL USAGE, AND AFTER EACH RAINFALL, WITH MAINTENANCE PROVIDED AS NECESSARY. PERIODIC TOP DRESSING SHALL BE DONE AS NEEDED.

DATE: 01/18/2007	NOT TO SCALE
REVISION	APPROVED
	DATE

CITY OF ELK GROVE - PUBLIC WORKS

STABILIZED CONSTRUCTION SITE ACCESS



DRAWING NUMBER
SQ - 1

APPROVED BY:

CITY ENGINEER