


TRANSITION GUTTER CROSS SLOPE TO 4.5% ALONG TOTAL LENGTH OF AREA OF RAMPED PORTION (TYP.)

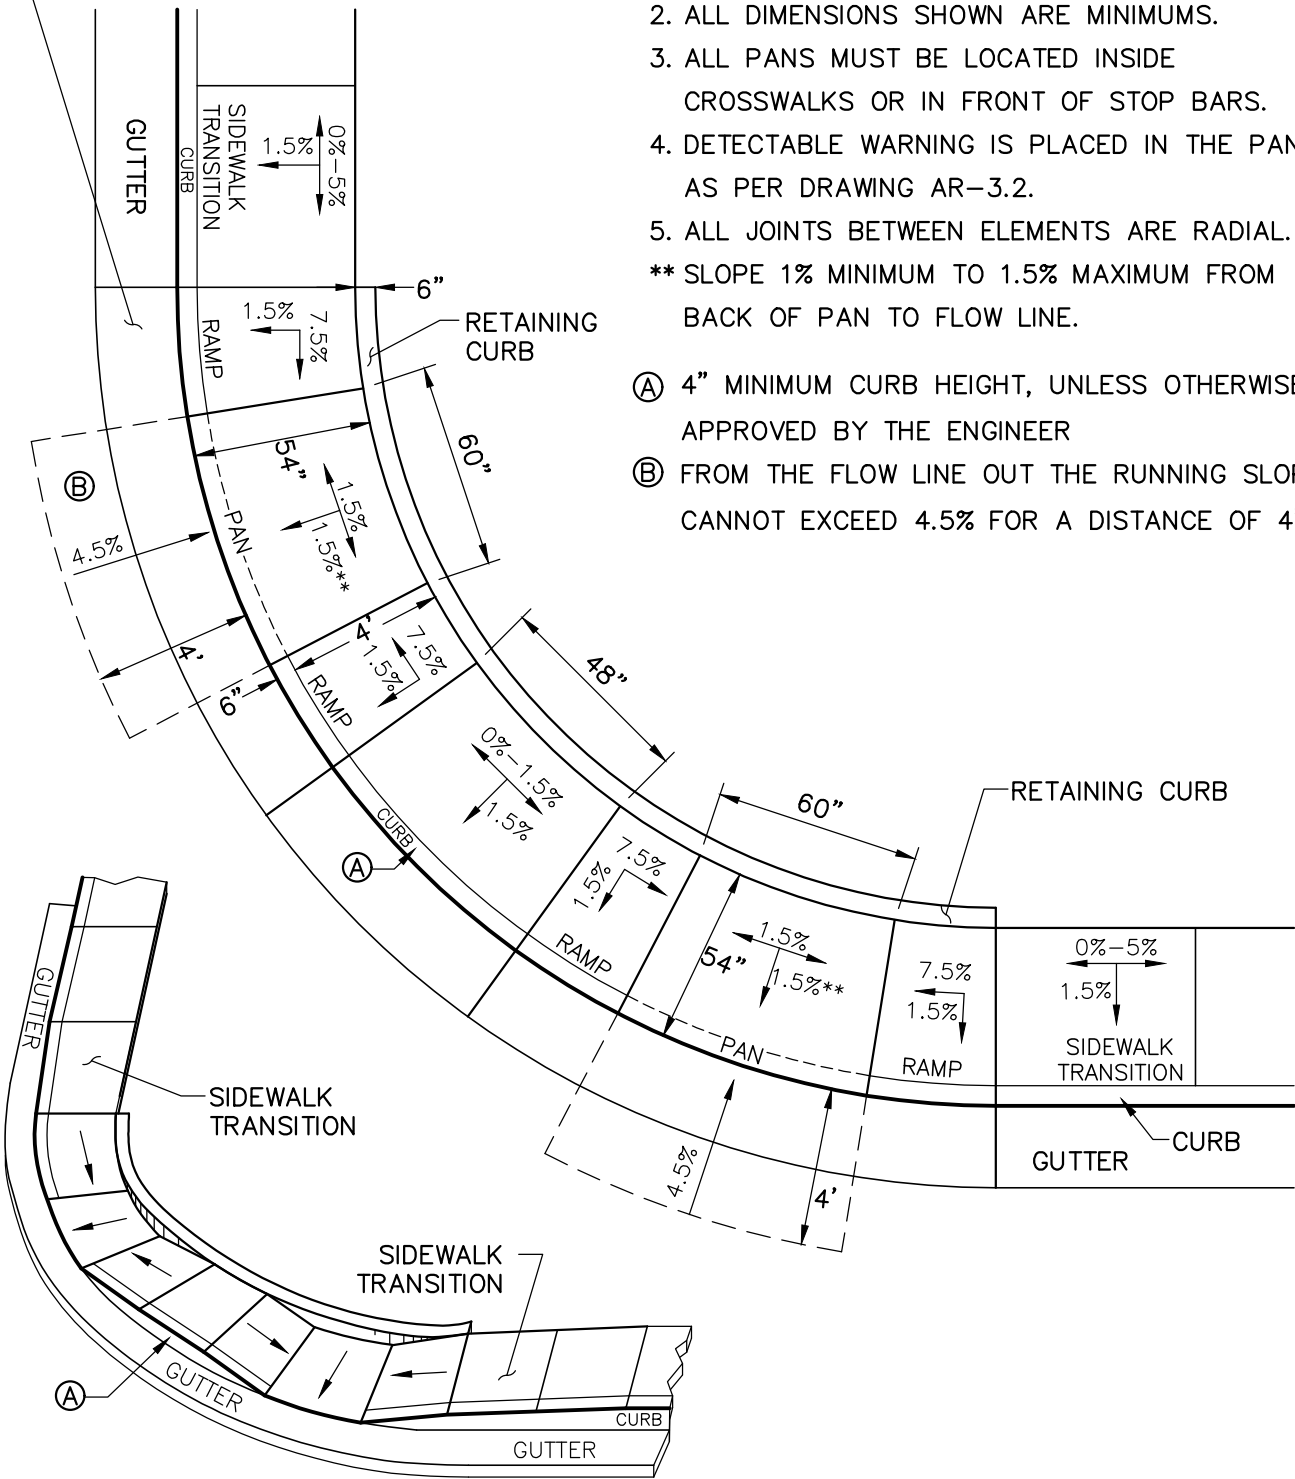

**NOTES:**

1. ALL SLOPES SHOWN ARE MAXIMUMS.
  2. ALL DIMENSIONS SHOWN ARE MINIMUMS.
  3. ALL PANS MUST BE LOCATED INSIDE CROSSWALKS OR IN FRONT OF STOP BARS.
  4. DETECTABLE WARNING IS PLACED IN THE PAN AS PER DRAWING AR-3.2.
  5. ALL JOINTS BETWEEN ELEMENTS ARE RADIAL.
- \*\* SLOPE 1% MINIMUM TO 1.5% MAXIMUM FROM BACK OF PAN TO FLOW LINE.
- Ⓐ 4" MINIMUM CURB HEIGHT, UNLESS OTHERWISE APPROVED BY THE ENGINEER
- Ⓑ FROM THE FLOW LINE OUT THE RUNNING SLOPE CANNOT EXCEED 4.5% FOR A DISTANCE OF 4'.

DATE: 09/22/2017		NOT TO SCALE	
REVISION	BY	APPROVED	DATE
1	LM	TW	07-18-2019

CITY OF ELK GROVE - PUBLIC WORKS

**DUAL PARALLEL CURB RAMPS**

APPROVED BY:  
*Paul M. ...*  
CITY ENGINEER

1/16/2020  
DATE

DRAWING NUMBER  
**AR - 4.1**

