


**NOTES:**

1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MOUNTING THE CAMERA ENCLOSURE ASSEMBLY AND POSITIONING IT AS DIRECTED BY THE ENGINEER. ALL MOUNTING EQUIPMENT AND MOUNTING METHODS SHALL BE AS SPECIFIED BY THE CAMERA MANUFACTURER.
2. WHERE CAMERAS ARE INSTALLED NEAR SIGNALIZED INTERSECTIONS, CAMERA CABLES/CONDUCTORS SHALL BE INSTALLED AND TERMINATED IN THE CONTROLLER CABINET WHERE ACTELIS SWITCH IS LOCATED.

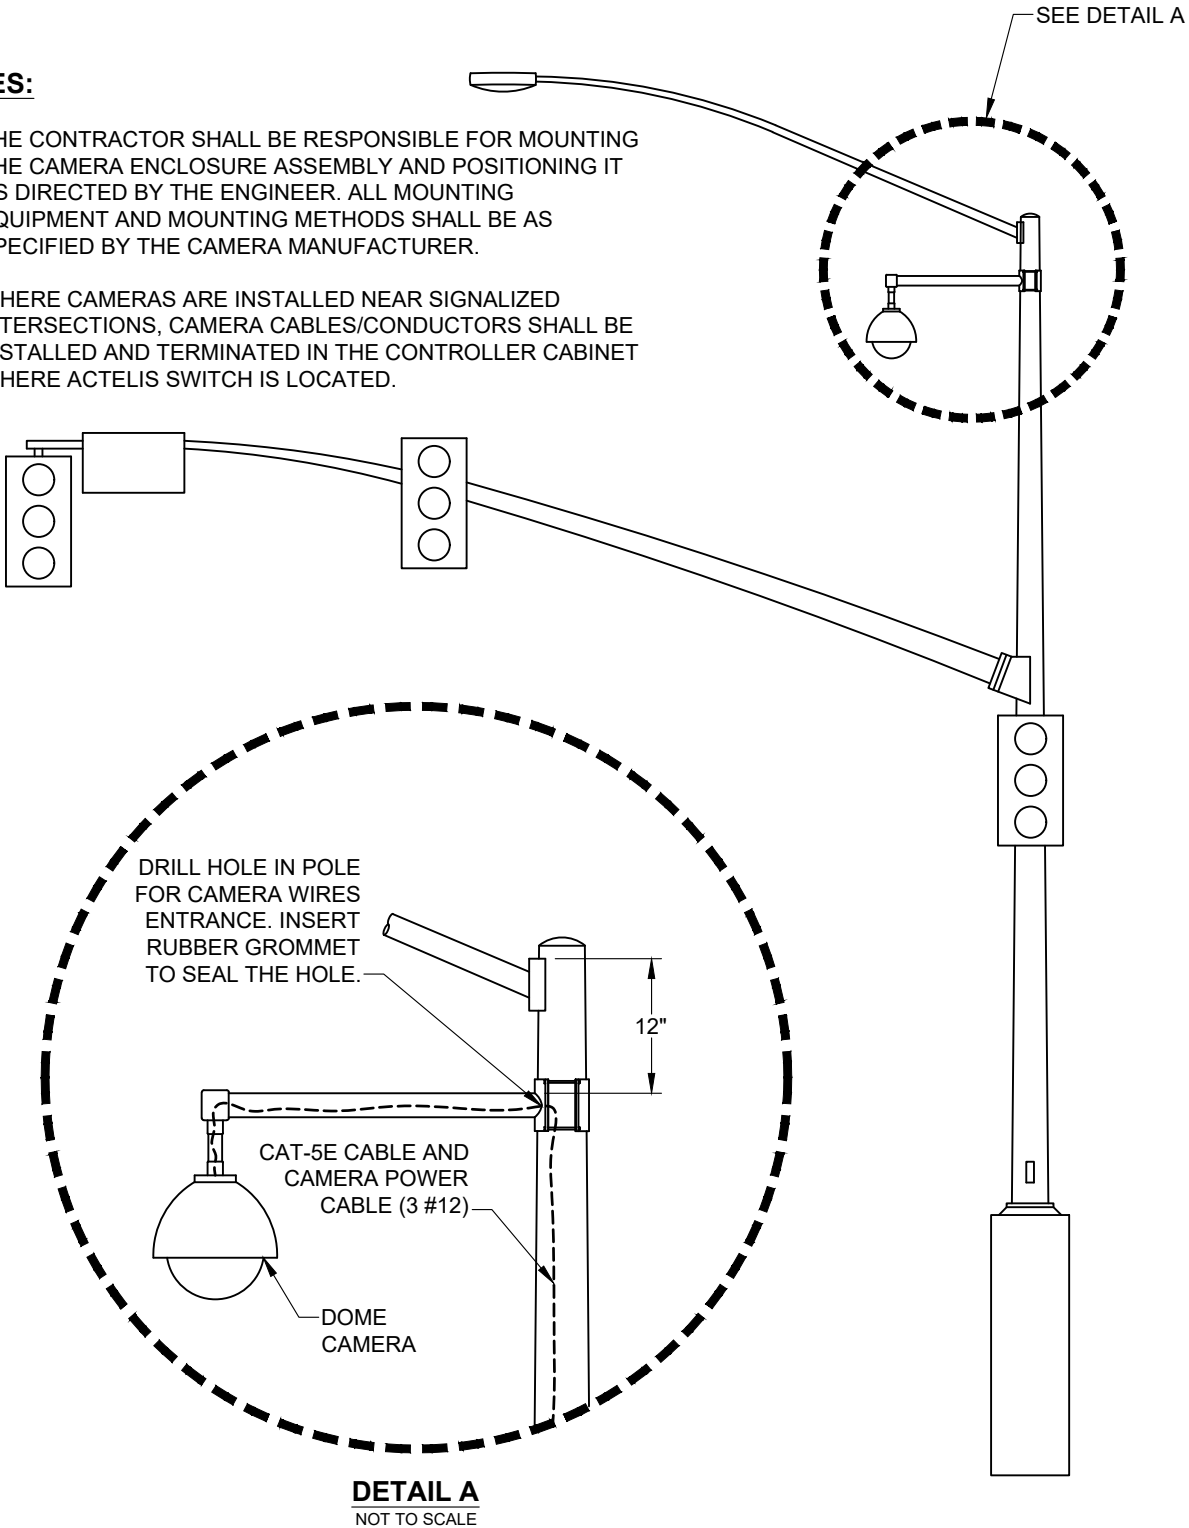

**DETAIL A**  
NOT TO SCALE

DATE: 09/22/2017		NOT TO SCALE	
REVISION	BY	APPROVED	DATE

CITY OF ELK GROVE - PUBLIC WORKS

**CCTV IP DOME CAMERA  
(SIGNAL POLE MOUNTED)**

APPROVED BY:  
*Robert M. ...*  
CITY ENGINEER      10/24/2018  
DATE



DRAWING NUMBER

**T - 20**