


NOTES:

- A. ALL SLOPES SHOWN ARE MAXIMUMS.
- B. ALL DIMENSIONS SHOWN ARE MINIMUMS.
- C. ALL PANS MUST BE LOCATED INSIDE CROSSWALKS OR IN FRONT OF STOP BARS.
- D. DETECTABLE WARNING IS PLACED IN THE PAN AND AS PER DRAWING AR - 3.2
- E. ALL JOINTS BETWEEN ELEMENTS ARE RADIAL.
- * CONSTRUCTED IF REQUIRED BY EXISTING CONDITIONS.
- ** MAXIMUM SLOPE OF 2% TO 1% FROM BACK OF PAN TO FLOW LINE.
- DESIGNATES IN PLAN VIEWS THAT ELEMENT MAY BE CONSTRUCTED.

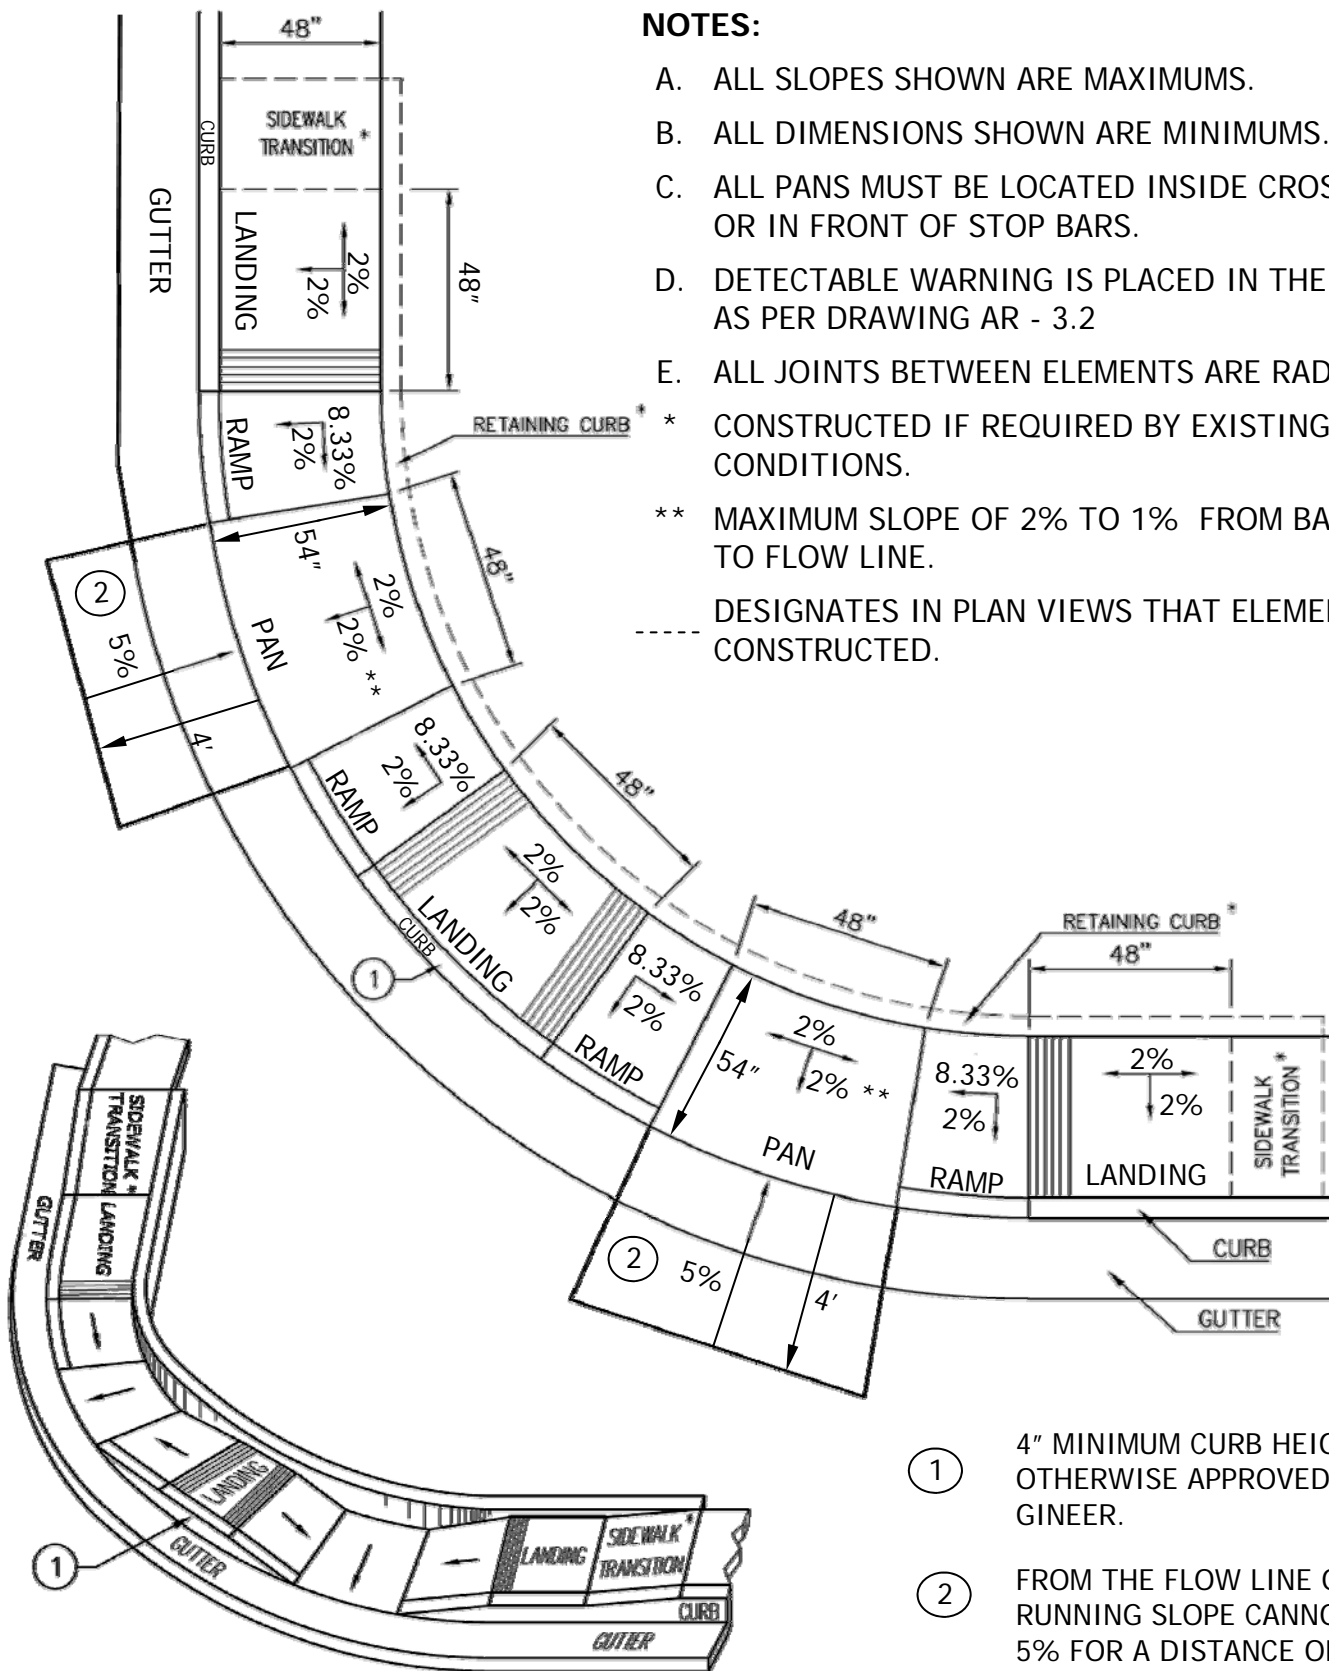

- ① 4" MINIMUM CURB HEIGHT, UNLESS OTHERWISE APPROVED BY THE ENGINEER.
- ② FROM THE FLOW LINE OUT THE RUNNING SLOPE CANNOT EXCEED 5% FOR A DISTANCE OF 4' .

DATE: 09/04/07		NOT TO SCALE	
REVISION	BY	APPROVED	DATE

CITY OF ELK GROVE - PUBLIC WORKS

APPROVED BY:

CITY ENGINEER

DUAL PAN CURB RAMPS

DRAWING NUMBER

AR - 4.1

