




W = 6' 0" MINIMUM
 W = 2 x PIPE DIAM. (3'+)

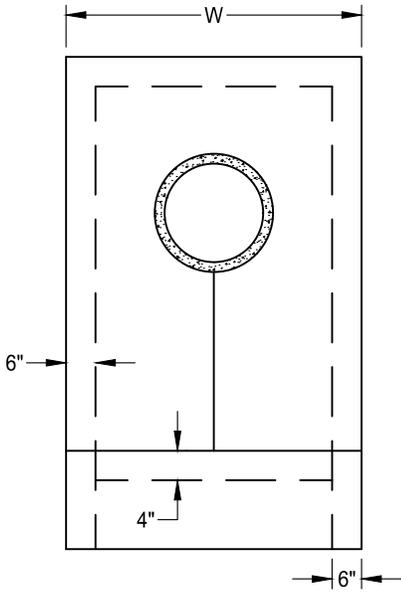


FRONT VIEW

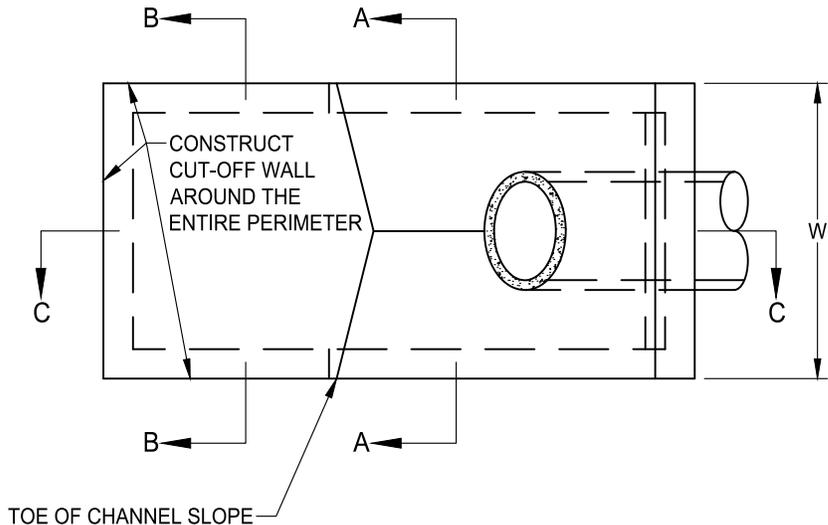


TOP VIEW

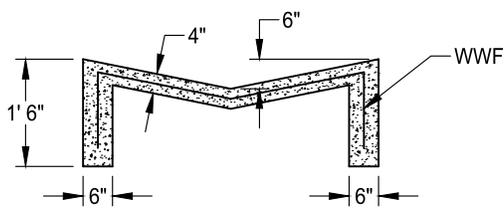

SECTION A-A

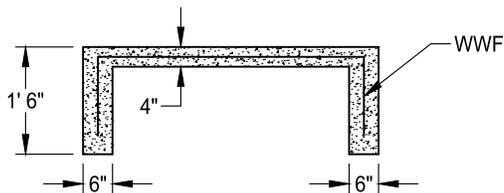


SECTION B-B

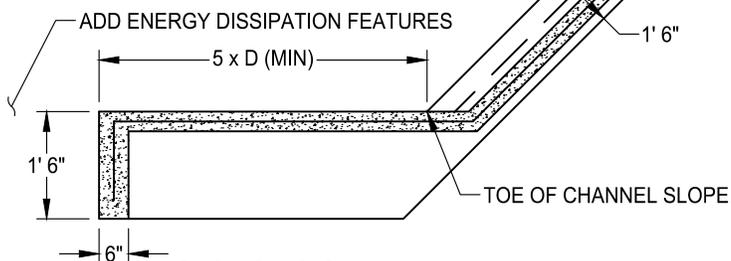

SECTION C-C

MITER CUT PIPE TO FIT FLUSH WITH SLOPE

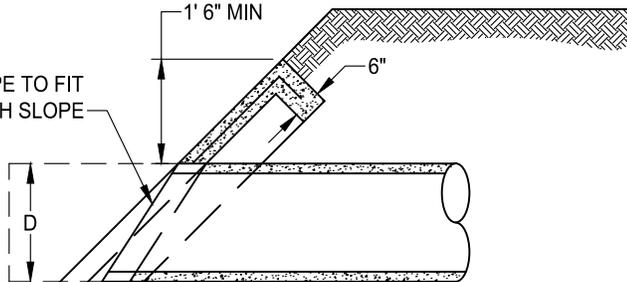

NOTES:

1. USE CLASS "B" CONCRETE.
2. 6" x 6" - W6 x W6 WWF THROUGHOUT CONCRETE.
3. ADD ENERGY DISSIPATION FEATURES SUCH AS COBBLES, RIP-RAPS, OR MOLDED CONCRETE AT END OF APRON.

DATE: 09/22/2017		NOT TO SCALE	
REVISION	BY	APPROVED	DATE

CITY OF ELK GROVE - PUBLIC WORKS

OUTLET PIPE HEADWALL AND APRON

APPROVED BY:
Paul Mulock
 CITY ENGINEER
 10/24/2018
 DATE



DRAWING NUMBER

SD - 26